


FLUORIDE

Water District No. 111 gets part of its water supply from the City of Auburn whose water is not fluoridated. Because this un-fluoridated water mixes with the District's fluoridated source, some areas receive fluoride levels below Department of Health recommendations. The blue area in the lower portion of the map below indicates the area that most likely has no fluoride. If you live in the area shown in yellow the blended water you receive has fluoride ranging from .2–1.3 parts per million (ppm). The Department of Health requires the District to notify all customers who do not receive fluoride in the range of .8-1.3 (ppm) so they can take fluoride supplements if needed. We do not anticipate the fluoridation to continually stay above the .8 ppm minimum in this area in the near future; however, if the situation changes, we will notify you. You are encouraged to discuss the matter with your dentist who can recommend fluoride treatments or supplements, as appropriate. ♦

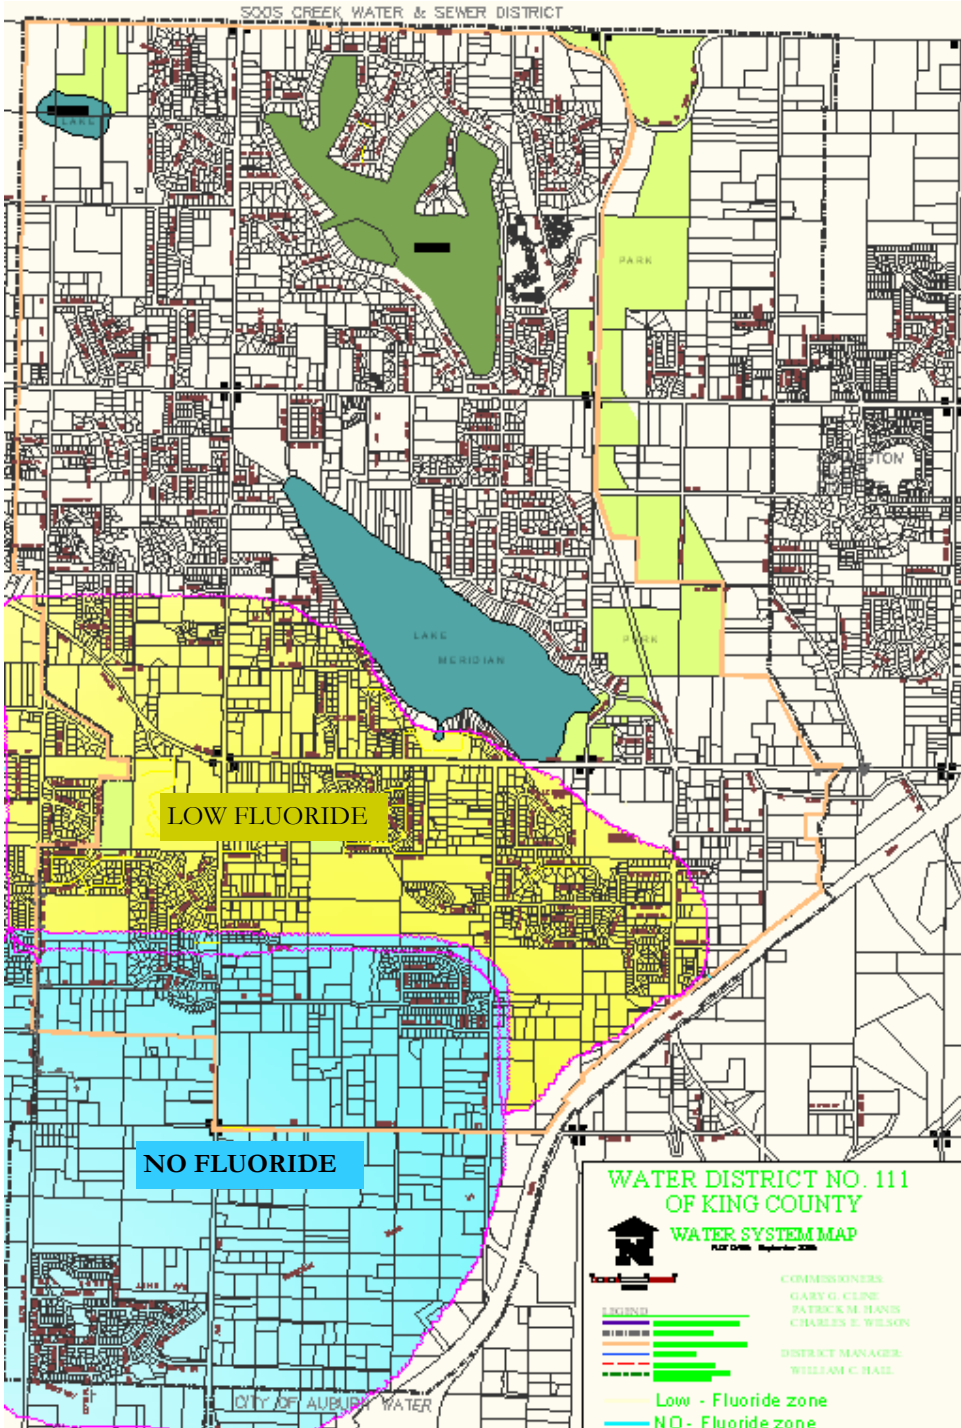

Find useful forms and information at: www.wd111.com

VALVES

Water District 111 will have two crews during the next four to six months exercising the water main valves throughout the district. The purpose is to make sure there is a record of where the valves are located and that they are operational in the event a broken water line occurs. If any valves are found defective or in need of replacement, these repairs will be made in an orderly and timely fashion, which will minimize unnecessary interruptions of water service to you the district customers. If at any time during this process you have any questions or concerns, please contact the District office. ♦

WATER DISTRICT No. 111
www.wd111.com
 27224 144th Ave SE
 Kent, WA 98042
customerservice@wd111.com
 (253) 631-3770

COMMISSIONERS
 Gary Cline
 Patrick Hanis
 Charles Wilson

GENERAL MANAGER
 Chris Hall

Meetings held the 2nd and 4th Thursdays of each month at 9:00 a.m. at the District office.